

Фотоотчет по инвестиционной программе АО «ОЭСК» за 3 квартал 2022 года

№п/п	наименование работ	фото
1	Автоматизированная система коммерческого учета электроэнергии (АСКУЭ) бытового уровня АО "ВК РЭК" в г.Семей, ВКО	

Модернизация и реконструкция ПС

№ п/п	наименование работ	фото
2	Фото реконструкции ПС 35/6кВ. № 2 в г. Семей	

Ведутся работы по комплексной Модернизации и реконструкции на
ПС 110/35/10кВ «Левобережная»

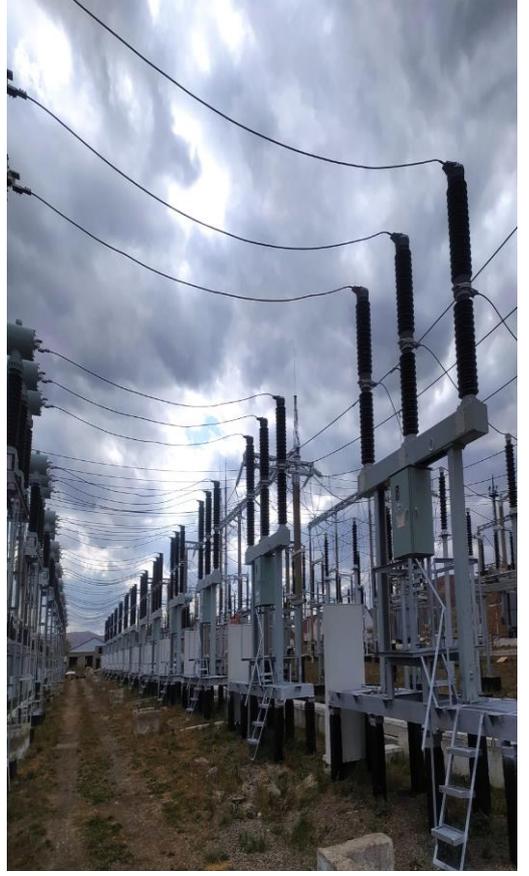


		фото до	после
	<p>Модернизация ПС 110/35/10 Теректы. Шкаф защит Л-110 кВ</p>		

		фото до	после
	<p>Замены масляных выключателей .6-10кВ на вакуумные на ПС-110/35/10 с.Новая Шульба</p>		

		фото до	после
	<p>Модернизация КТП-130-2 п.Левый берег. Замена на КТПБ-130-2 п.Левый берег</p>	 <p>A photograph of an old, heavily rusted metal transformer cabinet. The cabinet is mounted on a concrete base and has a door that is partially open, revealing internal components. The rust is extensive, covering most of the surface. There are some markings on the door, including a warning symbol and the number '250kVA'.</p>	 <p>A photograph of a new, modern transformer cabinet. The cabinet is dark grey or black with white panels on the doors. It is mounted on a concrete base and has a clean, professional appearance. There are warning symbols on the doors and some identification labels.</p>
	<p>Замена КРН-6/10 кВ на ПС-35/6КВ Таинты</p>	 <p>A photograph of old, rusted switchgear. The switchgear is made of metal and is heavily corroded. It has several compartments and is mounted on a concrete base. There are some markings on the front panels, including the number '10-2' and 'ТСН'.</p>	 <p>A photograph of new, modern switchgear. The switchgear is made of metal and is painted a light grey color. It has several compartments and is mounted on a concrete base. There are warning symbols on the front panels.</p>